

## **Technical Data Sheet**


Pressure / Temperature / Humidity / Air Velocity / Airflow / Sound level

# Humidity and temperature ambiant airtight transmitter **TH 110 – XXES**

## **KEY POINTS**

- Measuring range from 5 to 95% RH and from 0 to 50°C
- 0-10 V output, active, power supply 24 Vac/Vdc (3-4 wires) or 4-20 mA output, passive loop, power supply from 16 to 30 Vdc (2 wires)
- ABS V0 housing IP65
- · Alternating display of humidity and temperature
- "1/4 turn" system mounting with wall-mount plate
- · Housing with simplified mounting system

## FEATURES OF HOUSING

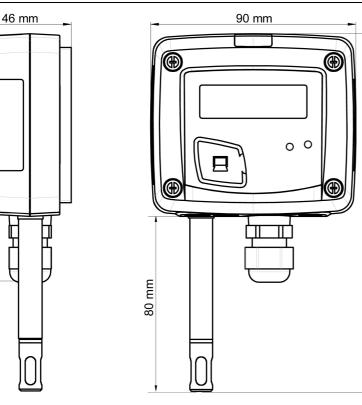

Material ABS V0 as per UL94

Protection IP65 (housing)

## Display

61 mm

LCD 10 digits. Size: 50 x 17 mm Alternating display of humidity and temperature

Height of digits Values: 10 mm Units: 5 mm


Cable gland For cables Ø8 mm maximum

Weight 135 g

#### PART NUMBER

109 mm

To order, just add the codes to complete the part number :

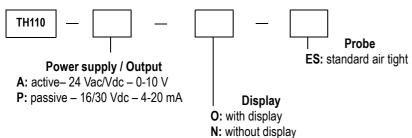

**Example : TH110 – ANES** Humidity and temperature transmitter TH110, 0-10 V active, without display, ambient model

**Caution:** the TH110 – POES model (passive with display) is not available.



## TECHNICAL FEATURES IN TEMPERATURE

		Output / Power supp	
Measuring range	from 0 to 50°C	• active sensor 0-10 V	
Accuracy*	±0.3°C (from -40°C à 70°C); ±0.5°C outside	Vac/Vdc ±10%), 3-4 • passive loop sensor	
Unit of measurement	°C / °F	supply 16/30 Vdc), 2	
Response time	1/e (63%) 15 s	<ul> <li>common mode volta</li> <li>maximum load: 500</li> </ul>	
Sensitive element	NTC	• minimum load: 1 K C	
Resolution	0.1°C	Consumption	
Type of fluid	Air and neutral gases	2 VA (0-10 V) or 1.2 V	

## TECHNICAL FEATURES IN HUMIDITY

Measuring range	From 5 to 95% RH
Analogue output	From 0 to 100% RH
Accuracy*	±1.5% RH (if 15°C ≤ T ≤ 25°C)
Drift linked to temperature	±0.04 x (T-20) %RH (if T < 15 °C or T > 25 °C)
Unit of measurement	% RH
Response time	1/e (63%) 4 s
Type of sensor	Capacitive
Resolution	0.1% RH
Factory adjustment uncertainty	±0.88% RH
Type of fluid	Air and neutral gases

All the accuracies indicated in this technical datasheet were stated in laboratory conditions, and can be guaranteed for measurements carried out in the same conditions, or carried out with calibration compensation.

## TECHNICAL SPECIFICATIONS

## Output / Power supply

- V (power supply 24 4 wires
- r 4-20 mA (power 2 wires
- age <30 VAC
- Ohms (4-20 mA)
- Ohms (0-10 V)
- VA (4-20 mA)

## **European directives**

2014/30/EC EMC 2014/35/EC Low Voltage 2011/65/EU RoHS II 2012/19/EU WEEE

#### **Electrical connection**

Screw terminal block for cables from 0.05 to 2.5 mm<sup>2</sup> or from 30 to 14 AWG Carried out according to the code of good practice

**PC** communication USB-mini Din cable

Environment Air and neutral gases

## Conditions of use (°C/%RH/m)


From 0 to +50°C. In non-condensing condition. From 0 to 2000 m.


Operating temperature of the probe From -20 to +80°C

Storage temperature From -10 to +70°C

## CONNECTIONS


## Inside the front housing



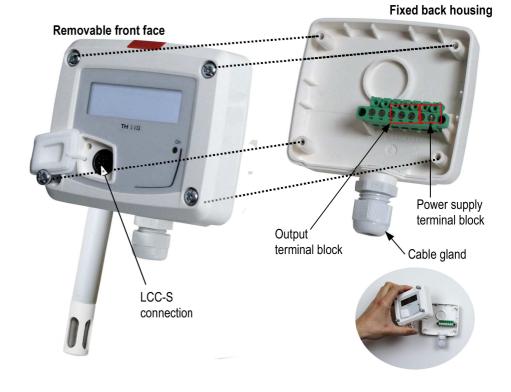

This connection must be made by a qualified and trained technician. To make the connection, the transmitter must not be energized.

For TH110-AOES, TH110-ANES models with 0-10 V output - active :

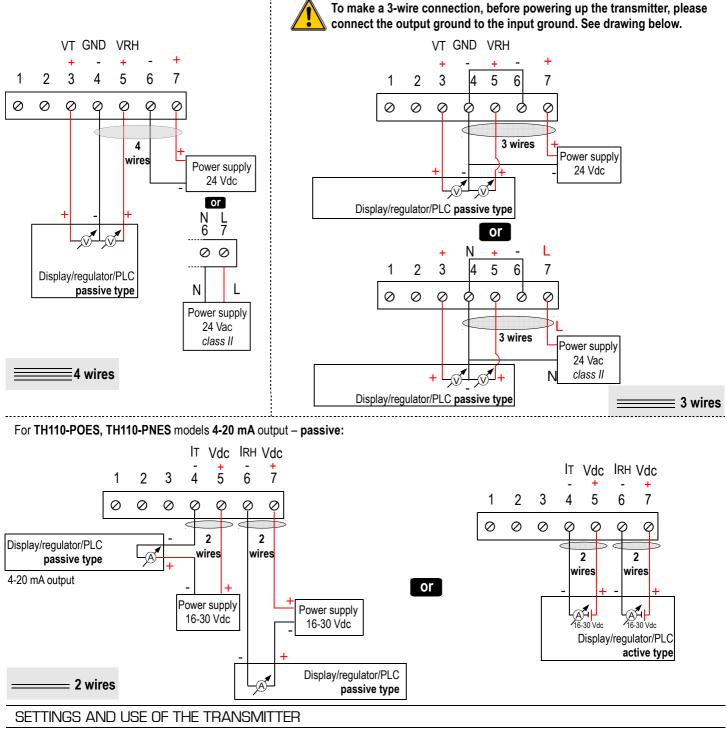

#### - Configuration


It is possible to set the measuring ranges and the unit of the instrument either by switch and/or via software.



# To configure the transmitter, it must not be energized. Then, you can make the settings required, with the DIP switches (as shown on the drawing below). When the transmitter is configured, you can power it up.

#### Configuration by switch

To configure the transmitter, unscrew the 4 screws from the housing then open it. DIP switches allowing the different settings are then accessible





Please follow carefully the combinations beside with the DIP switch. If the combination is wrongly done, the following message will appear on the display of the transmitter "CONF ERROR". In that case, you will have to unplug the transmitter, place the DIP switches correctly, and then power the transmitter up.

## - Units setting - active switch

To set a unit of measurement, put the on-off switch 4 of the units as shown below.

Configurations	°C	۴
Combinations	1 2 3 4	1 2 2 3 3 4 4 4 5 5 5 5 5 5 5 5 5 5 5 5 5 5 5

## - Outputs setting - active switch

To set an output, put the on-off switches 1, 2 et 3 of the measuring ranges as shown below.

Configurations	From 0 to +50°C	From -20 to +80°C	From -50 to +50°C	From 0 to 100°C
Combinations	1 2 3 4	1 2 2 3 3 4 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1		$ \begin{array}{c} 1 \\ 2 \\ 3 \\ 4 \\ \end{array} $

## CONFIGURATION VIA LCC-S SOFTWARE (option)

## An easy and friendly configuration with the software!

It is possible to configure intermediate ranges, an offset

Example: for a 0-100°C transmitter, minimum delta minimum is 20°C. The instrument can be configured from 0 to +20°C or from -10 to +10°C.


In order to compensate a possible drift of the sensor, it is possible to add an offset to the displayed value by the TH110 transmitter: it shows 48% RH, a standard instrument shows 45% RH. It is then possible, via the software, to integrate an offset of -3 to the displayed value by the TH110 instrument.

· To access the configuration via software :

- Set the DIP switches as shown beside.
- Connect the cable of the LCC-S to the connection of the transmitter.

• Please refer to the user manual of the LCC 100 to make the configuration.

## The configuration of the parameters can be done either with the DIP switch or via software (you can not combine both solutions).

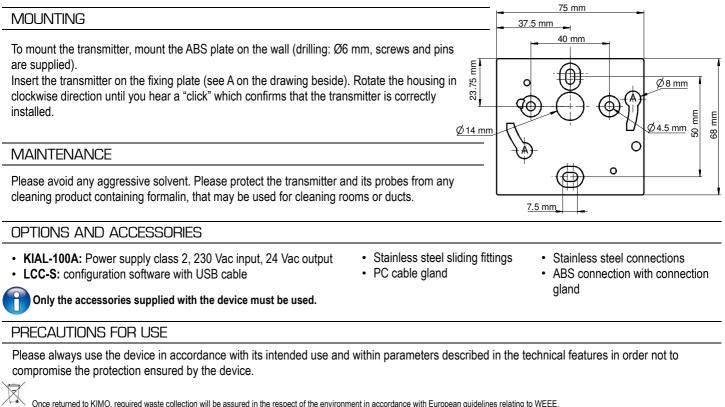

Once returned to KIMO, required waste collection will be assured in the respect of the environment in accordance with European guidelines relating to WEEE.

#### www.kimo.fr



EXPORT DEPARTMENT Tel: + 33. 1. 60. 06. 69. 25 - Fax: + 33. 1. 60. 06. 69. 29 e-mail : export@kimo.fr

Distributed by :